




UL FIRE RATED

PAGE 1 OF 1

Design No. x902

Rating - 4 HR.

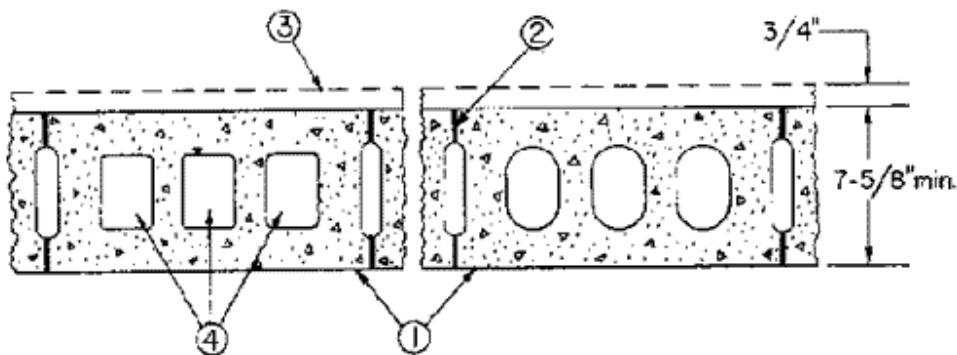

Steel Column - Minimum size W10x49 with minimum air space from web to block of 8 in. and from flange to block of $3 \frac{3}{16}$ in. See above illustration.

Concrete Blocks* - Various designs. Classification D-2 (2 hr).

Thick Bed Mortar - Blocks laid in $\frac{3}{8}$ in. thick bed mortar of cement-lime Type S masonry cement and installed with vertical joints staggered or unstaggered.

*Bearing the UL Classification Marking